

## TANK CEASING


Your quick start guide for our industry leading series of Acid Tanks designed, enginneered, and built from the ground up, with you in mind.




## THE FRONT

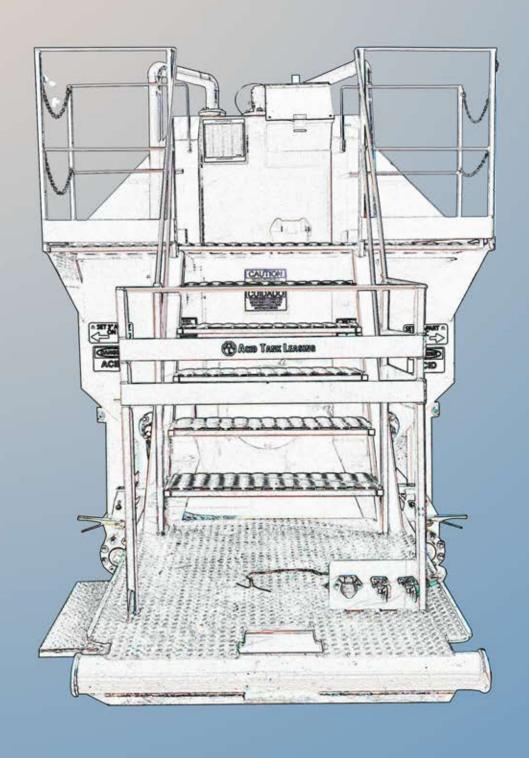


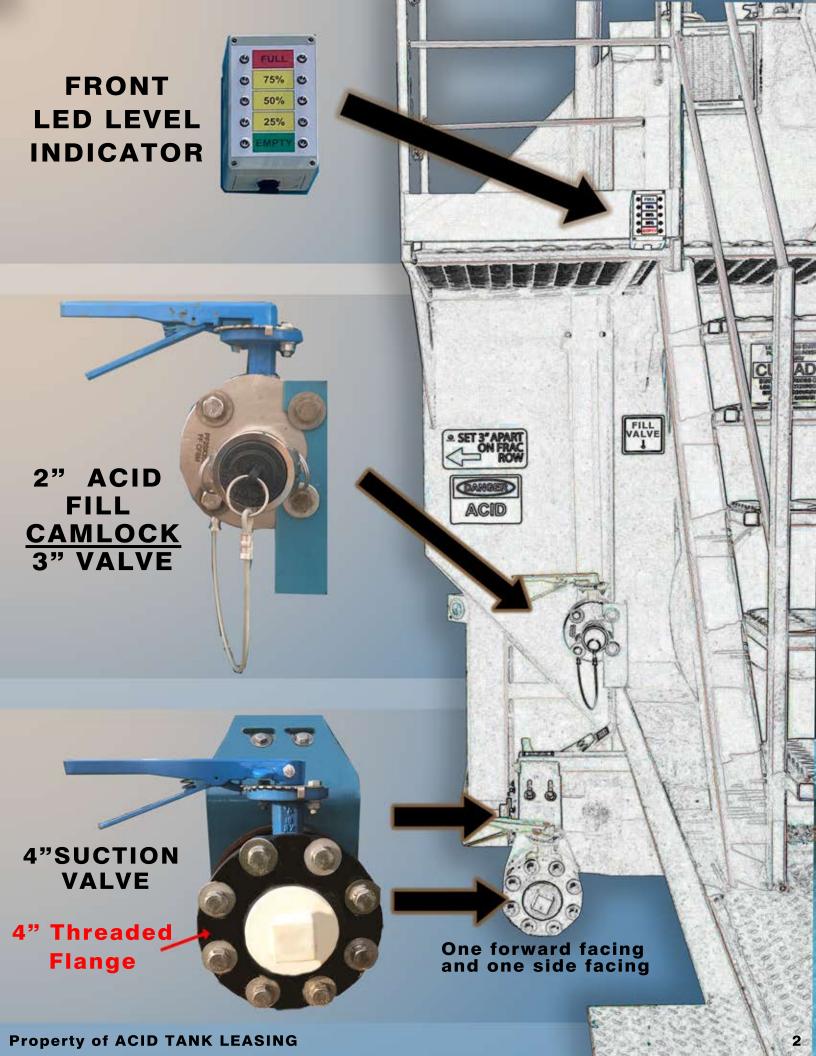


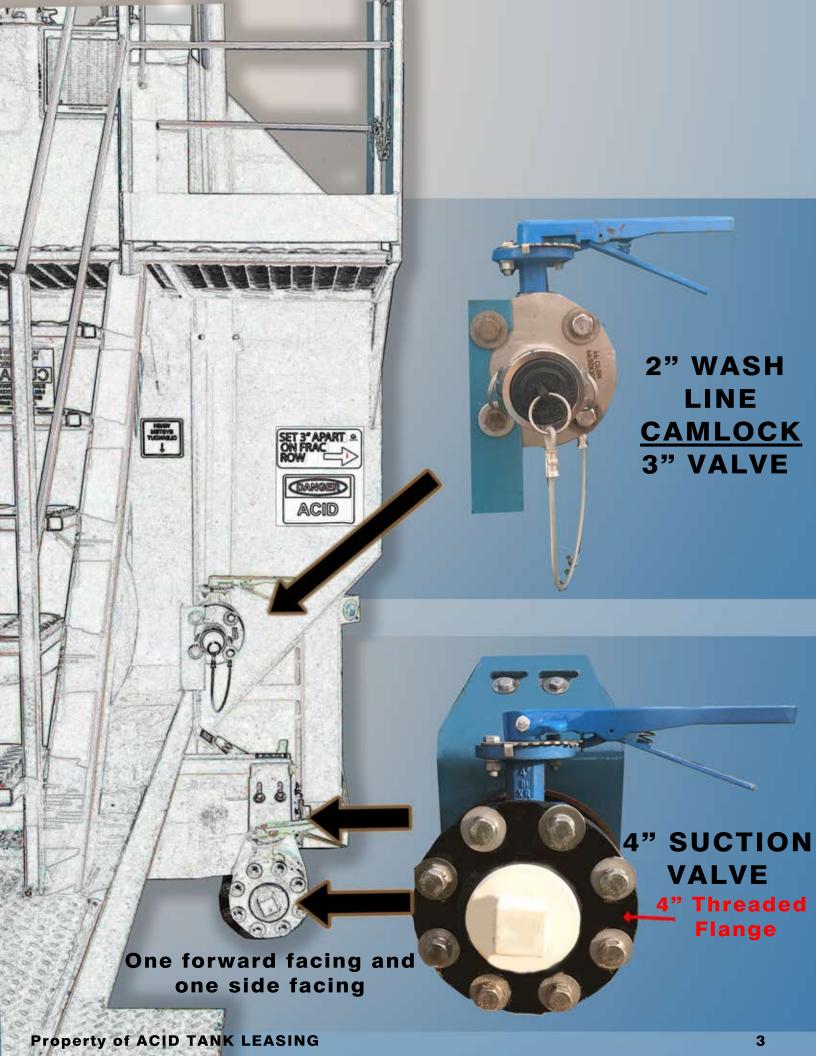


## WORK PLATFORM

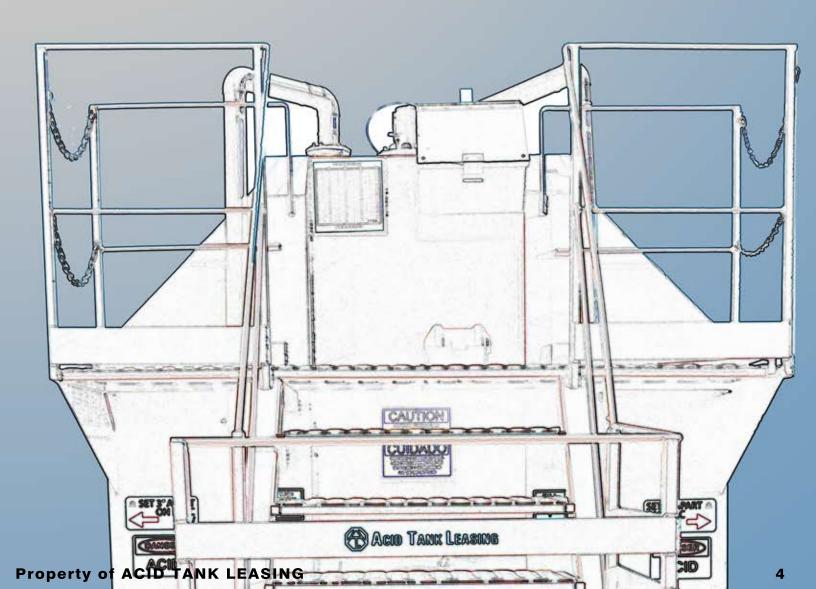









#### **BARREL CHART**





#### ELECTRICAL BOX INTERIOR

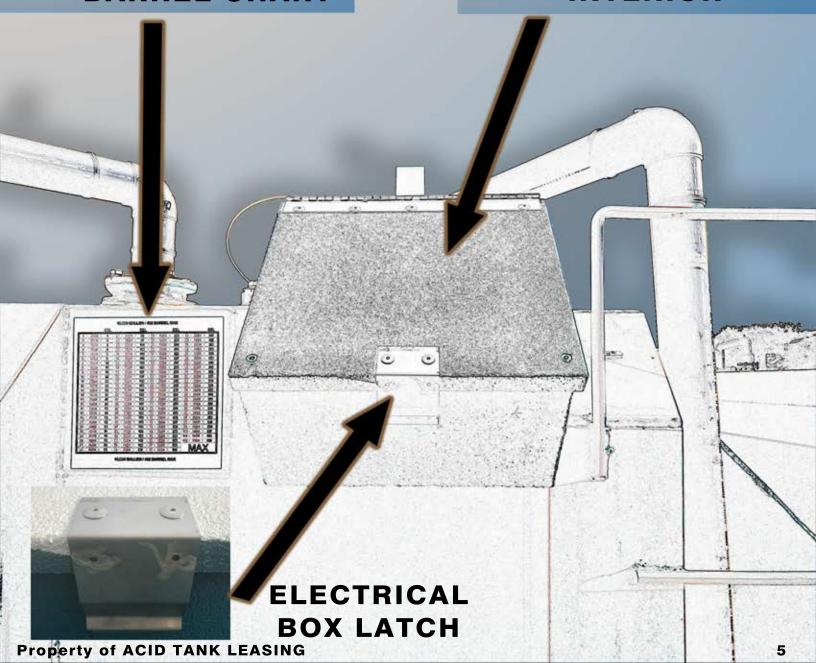

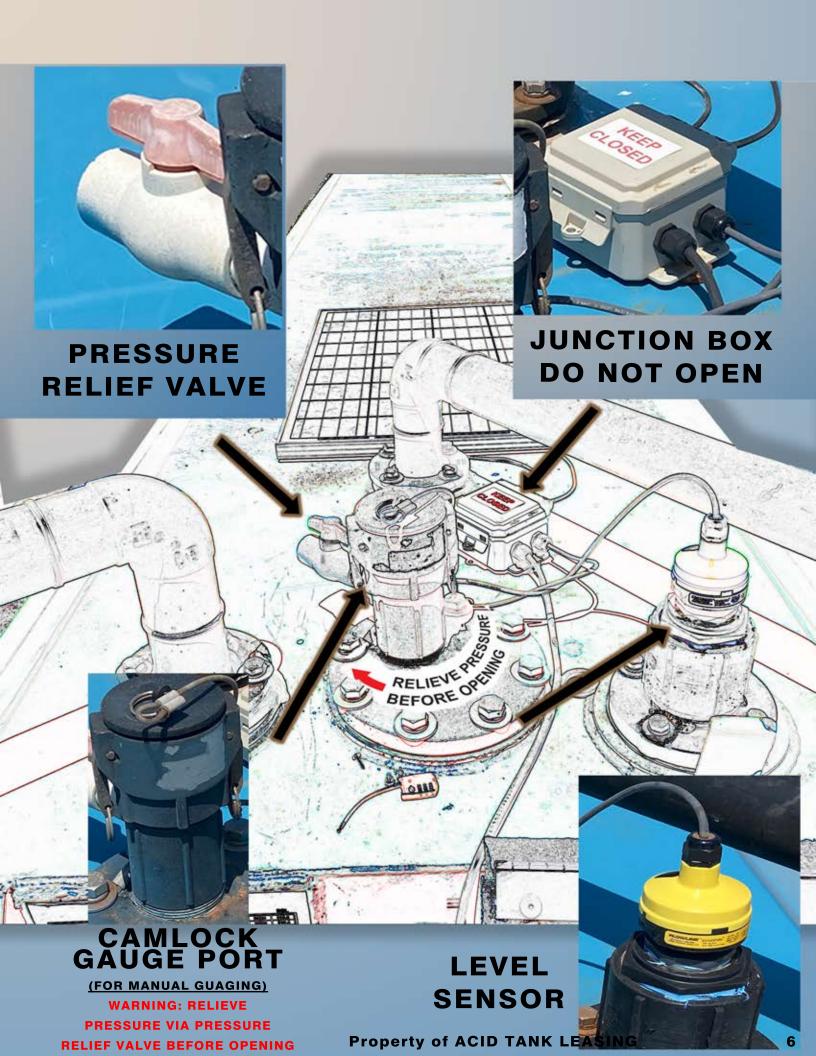


## THE BACK

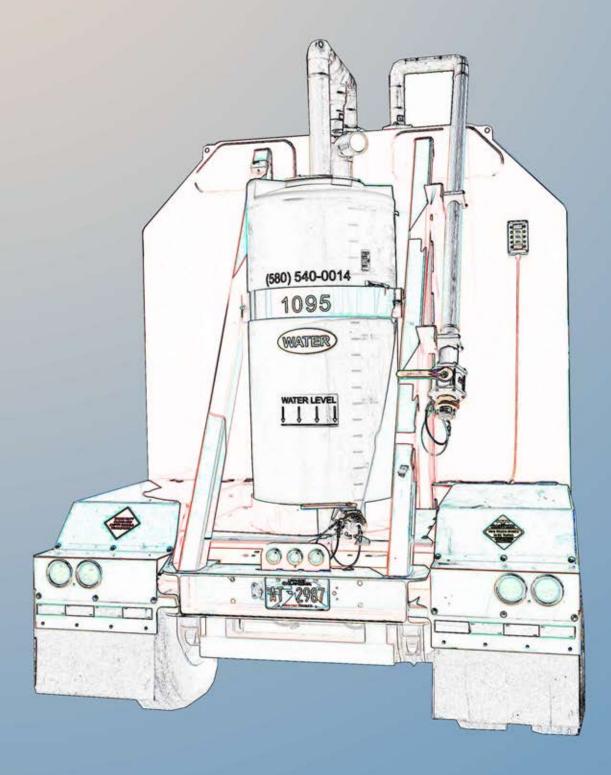

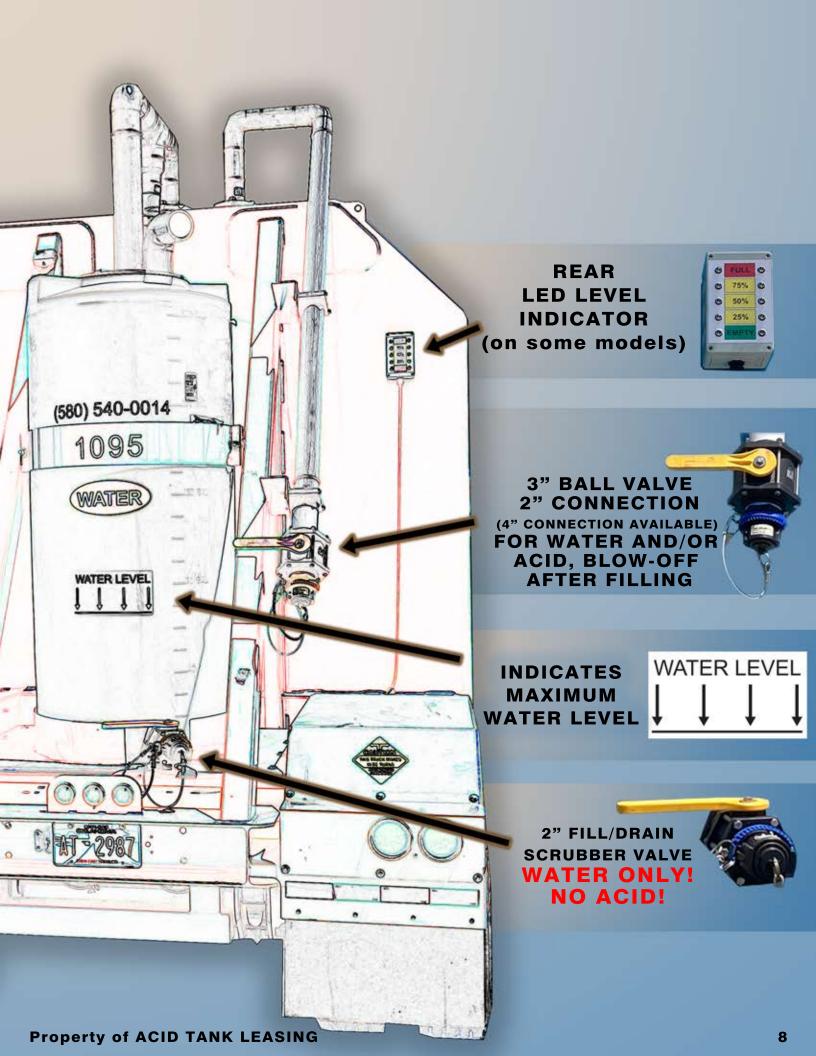



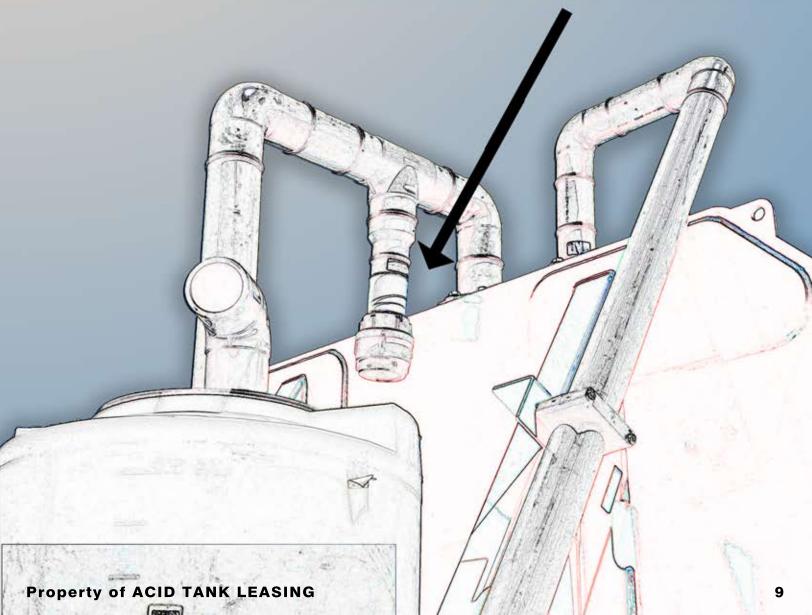

#### **SCRUBBER SYSTEM**

REDUCES THE HCL FUMES DOWN TO LESS THAN 2 PPM

SCRUBBER SHOULD BE FILLED WITH FRESH WATER ONLY UNLESS DIRECTED BY ATL PERSONNEL

WATER SHOULD BE DRAINED AND REPLACED EVERY 15 TO 25 DAYS DEPENDING ON HEAVINIESS OF USE

THE HIGHER CONCENTRATION OF ACID BEING USED, THE MORE FREQUENT THE WATER SHOULD BE DRAINED AND REPLACED

IN WINTER OR OTHERWISE COLD
AND FREEZING ENVIRONMENTS,
BRINE WATER OR A GLYCOL MIX
OF ONE GALLON FOR EVERY 60
GALLONS OF FRESH WATER
MAY BE SUBSTITUTED
FOR FRESH WATER ONLY

FOR INFO PLEASE CONTACT ATL CORPORATE OFFICE AT (580) 540-0014 OR YOUR LOCAL AFFILIATE. (580) 540-0014

1095

WATER

WATER

WATER LEVEL

J J J J

# get FUMES?



(580) 540-0014